

PR



5725

**Programmable
frequency indicator**

No. 5725V100-UK

From ser. no. 100687001



SIGNALS THE BEST

- DK** ▶ PR electronics A/S tilbyder et bredt program af analoge og digitale signalbehandlingsmoduler til industriel automation. Programmet består af Isolatorer, Displays, Ex-barrierer, Temperaturtransmittere, Universaltransmittere mfl. Vi har modulerne, du kan stole på i selv barske miljøer med elektrisk støj, vibrationer og temperaturudsving, og alle produkter opfylder de strengeste internationale standarder. Vores motto »Signals the Best« er indbegrebet af denne filosofi – og din garanti for kvalitet.
- UK** ▶ PR electronics A/S offers a wide range of analogue and digital signal conditioning devices for industrial automation. The product range includes Isolators, Displays, Ex Interfaces, Temperature Transmitters, and Universal Devices. You can trust our products in the most extreme environments with electrical noise, vibrations and temperature fluctuations, and all products comply with the most exacting international standards. »Signals the Best« is the epitome of our philosophy – and your guarantee for quality.
- FR** ▶ PR electronics A/S offre une large gamme de produits pour le traitement des signaux analogiques et numériques dans tous les domaines industriels. La gamme de produits s'étend des transmetteurs de température aux afficheurs, des isolateurs aux interfaces SI, jusqu'aux modules universels. Vous pouvez compter sur nos produits même dans les conditions d'utilisation sévères, p.ex. bruit électrique, vibrations et fluctuations de température. Tous nos produits sont conformes aux normes internationales les plus strictes. Notre devise »SIGNALS the BEST« c'est notre ligne de conduite - et pour vous l'assurance de la meilleure qualité.
- DE** ▶ PR electronics A/S verfügt über ein breites Produktprogramm an analogen und digitalen Signalverarbeitungsmodulen für die industrielle Automatisierung. Dieses Programm umfasst Displays, Temperaturtransmitter, Ex- und galvanische Signaltrenner, und Universalgeräte. Sie können unsere Geräte auch unter extremen Einsatzbedingungen wie elektrisches Rauschen, Erschütterungen und Temperaturschwingungen vertrauen, und alle Produkte von PR electronics werden in Übereinstimmung mit den strengsten internationalen Normen produziert. »Signals the Best« ist Ihre Garantie für Qualität!

PROGRAMMABLE FREQUENCY INDICATOR 5725

CONTENTS

Warning	2
Safety instructions.....	3
EC declaration of conformity	5
Front and back layout	6
Application	7
Technical characteristics	7
Connections	8
Electrical specifications.....	9
Order: 5725	9
Sensor error indication, inside and outside range	13
Connections	14
Block diagram	15
Configuration / operating the function keys	16
Password protection	17
Routing diagram for 5725A.....	18
Routing diagram for 5725D.....	20
Scrolling help texts.....	22
Graphic depiction of the relay function setpoint.....	24



GENERAL

WARNING

This device is designed for connection to hazardous electric voltages. Ignoring this warning can result in severe personal injury or mechanical damage. To avoid the risk of electric shock and fire, the safety instructions of this manual must be observed and the guidelines followed. The specifications must not be exceeded, and the device must only be applied as described in the following. Prior to the commissioning of the device, this manual must be examined carefully. Only qualified personnel (technicians) should install this device.

If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.



**HAZARD-
OUS
VOLTAGE**



WARNING

Until the device is fixed, do not connect hazardous voltages to the device.

The following operations should only be carried out on a disconnected device and under ESD safe conditions:

Troubleshooting the device.

Repair of the device must be done by PR electronics A/S only.

SYMBOL IDENTIFICATION



Triangle with an exclamation mark: Warning / demand. Potentially lethal situations.



The CE mark proves the compliance of the device with the essential requirements of the directives.

SAFETY INSTRUCTIONS

DEFINITIONS

Hazardous voltages have been defined as the ranges: 75 to 1500 Volt DC, and 50 to 1000 Volt AC.

Technicians are qualified persons educated or trained to mount, operate, and also troubleshoot technically correct and in accordance with safety regulations. Operators, being familiar with the contents of this manual, adjust and operate the knobs or potentiometers during normal operation.

RECEIPT AND UNPACKING

Unpack the device without damaging it. The packing should always follow the device until this has been permanently mounted. Check at the receipt of the device whether the type corresponds to the one ordered.

ENVIRONMENT

Avoid direct sunlight, dust, high temperatures, mechanical vibrations and shock, as well as rain and heavy moisture. If necessary, heating in excess of the stated limits for ambient temperatures should be avoided by way of ventilation.

All devices fall under Installation Category II, Pollution Degree 2, and Insulation Class II.

MOUNTING

Only technicians who are familiar with the technical terms, warnings, and instructions in the manual and who are able to follow these should connect the device.

Should there be any doubt as to the correct handling of the device, please contact your local distributor or, alternatively,

PR electronics A/S
www.prelectronics.com

Mounting and connection of the device should comply with national legislation for mounting of electric materials, i.e. wire cross section, protective fuse, and location. Descriptions of Input / Output and supply connections are shown in the block diagram and side label.

The following apply to fixed hazardous voltages-connected devices:

The max. size of the protective fuse is 10 A and, together with a power switch, it shall be easily accessible and close to the device. The power switch shall be marked as the disconnecting unit for the device.

UL INSTALLATION REQUIREMENTS

For use on a flat surface of a type 1 enclosure.

Use 60/75°C copper conductors only.

Enclosure rating (face only)..... Type 4X, UL50E

Max. ambient temperature..... 60°C

Max. wire size, pins 41...46..... AWG 30-16

Max. wire size, others AWG 30-12

UL file number E248256

CALIBRATION AND ADJUSTMENT

During calibration and adjustment, the measuring and connection of external voltages must be carried out according to the specifications of this manual. The technician must use tools and instruments that are safe to use.

NORMAL OPERATION

Operators are only allowed to adjust and operate devices that are safely fixed in panels, etc., thus avoiding the danger of personal injury and damage. This means there is no electrical shock hazard, and the device is easily accessible.

CLEANING

When disconnected, the device may be cleaned with a cloth moistened with distilled water.

LIABILITY

To the extent the instructions in this manual are not strictly observed, the customer cannot advance a demand against PR electronics A/S that would otherwise exist according to the concluded sales agreement.

EC DECLARATION OF CONFORMITY

As manufacturer

PR electronics A/S
Lerbakken 10
DK-8410 Rønde

hereby declares that the following product:

Type: 5725
Name: Programmable frequency indicator

is in conformity with the following directives and standards:

The EMC Directive 2004/108/EC and later amendments

EN 61326-1 : 2006

For specification of the acceptable EMC performance level, refer to the electrical specifications for the device.

The Low Voltage Directive 2006/95/EC and later amendments

EN 61010-1 : 2001

Rønde, 11 June 2012




Kim Rasmussen
Manufacturer's signature

FRONT AND BACK LAYOUT



Picture 1: Front of 5725.

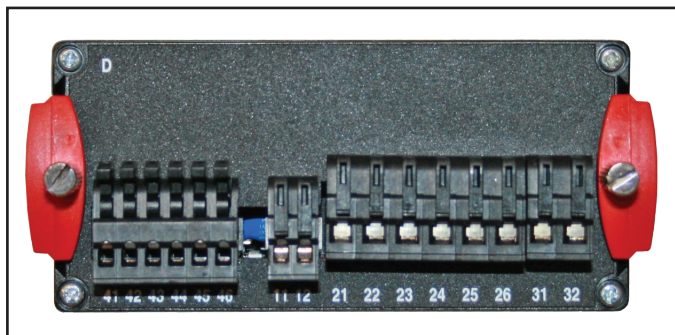

Picture 2: Back of 5725.

PROGRAMMABLE FREQUENCY INDICATOR 5725

- *Frequencies from 0.001 Hz to 50 kHz*
- *Input for various sensors; NPN, PNP, Contact, Namur, S0, Tacho and TTL*
- *2 SPDT relays and analogue output*
- *4-digit, 14-segment easily readable LED display*
- *Universal supply voltage*

Application

- 5725 is a digital indicator for readout of frequency signals and pulse signals.
- Typical applications are indication and conversion of process speed measurements and flow rate.
- The indicator can also be used for measuring the passing time on e.g. a conveyor line, as the 5725 can handle period time measurements.
- Process control is possible as the type 5725D contains 2 pairs of potential-free change-over relays and an analogue output.
- The display offers IP65 protection from the front and the splash-proof cover - PR type 8335 - can be used against atmospheres and liquids.

Technical characteristics


- 4-digit LED indication with 13.8 mm 14-segment characters for a -1999...9999 display readout with programmable decimal point.
- Relay ON / OFF indication via front LED's.
- Various input sensor types and custom current and voltage trig levels can be selected via the programming menu.
- Input and supply of NPN and PNP proximity switches is possible from the input terminals.
- A menu item allows the user to minimise the installation test time for the relay outputs by activating or deactivating each relay independently of the input signal.

Mounting / installation


- Panel mounted indicator, 48x96mm which obtains IP65 (type 4X) when using the rubber gasket provided.
- All standard operational parameters can be adjusted to any application by way of the front function keys.
- Help texts in eight different languages are available and can be selected via a menu item.

CONNECTIONS


Input signals:

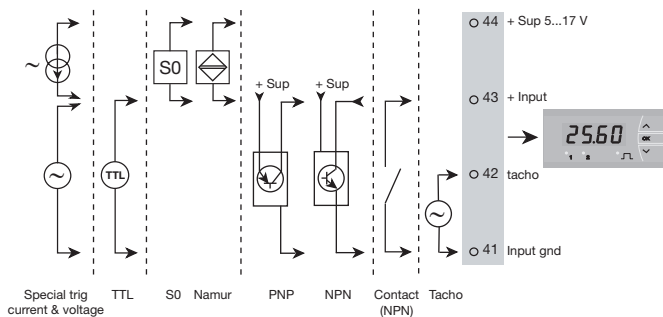

Output signals:

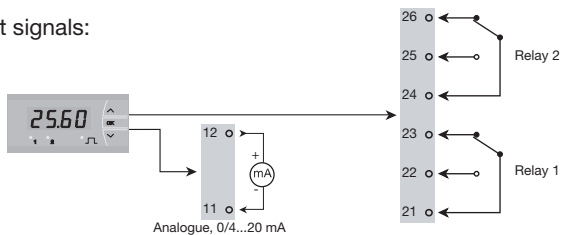

Supply:

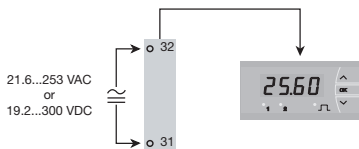

Order: 5725

Type	Version
5725	Standard.....: A
	Analogue output and 2 relays ..: D

Accessories: 8335 = Splash proof front

Electrical specifications

Environmental conditions:

Specifications range.....	-20°C to +60°C
Storage temperature	-40°C to +85°C
Calibration temperature.....	20...28°C
Relative humidity	< 95% RH (non-cond.)
Protection degree.....	IP20
Installation in pollution degree 2 & overvoltage category II.	

Mechanical specifications:

Dimensions (H x W x D)	48 x 96 x 120 mm
Cutout dimensions	44.5 x 91.5 mm
Protection degree (mounted in panel).....	IP65 / Type 4X, UL50E
Weight	230 g
Wire size, pin 11-12 & 41-44, max.....	1 x 1.5 mm ² / AWG 30...16 stranded wire
Wire size, others, max.....	1 x 2.5 mm ² / AWG 30...12 stranded wire
Terminal connection	Spring-cage

Common electrical specifications:

Supply voltage, universal	21.6...253 VAC, 50...60 Hz or 19.2...300 VDC
Max consumption, 5725A / 5725D	2.8 W / 3.6 W
Isolation voltage, test / operation	2.3 kVAC / 250 VAC
Signal / noise ratio	> 60 dB

Input:**General:**

Frequency range, F/I conversion function 0.001 Hz to 50 kHz
 Time range, Period time function..... 999.9 sec to 20 μ sec
 Response time (0...90%, 100...10%) < 1 period + 100 msec
 Low cut off frequency 0.0009 Hz
 Low cut off period time 1111 sec
 Max. frequency, with input filter ON 50 Hz

Accuracy values		
Specification	Absolute accuracy	Temperature coefficient
Input to Display & Relays	$\leq \pm 0.05\%$	$\leq \pm 0.01\% / ^\circ\text{C}$
Input to Analogue Output	$\leq \pm 0.1\%$	

EMC immunity influence	< $\pm 0.5\%$ of span
Extended EMC immunity: NAMUR NE 21, A criterion, burst	< $\pm 1\%$ of span

NAMUR input - acc. to EN 60947-5-6:

Trig-level LOW ≤ 1.2 mA
 Trig-level HIGH ≥ 2.1 mA
 Input impedance $1\text{ k}\Omega / < 1.5\text{ nF}$
 Breakage detection ≤ 0.1 mA
 Short-circuit detection..... ≥ 6.9 mA
 Sensor supply - pin 44, fixed 8.3 V

Tacho input:

Trig-level LOW $\leq - 50$ mV
 Trig-level HIGH $\geq + 50$ mV
 Input impedance $\geq 100\text{ k}\Omega / < 1.5\text{ nF}$
 Max. input voltage..... 80 VAC pp
 Sensor supply - pin 44, programmable $5 - 17\text{ V} / 20\text{ mA}$

NPN / PNP input:

Trig-level LOW $\leq 4.0\text{ V}$
 Trig-level HIGH $\geq 7.0\text{ V}$
 Input impedance $3.48\text{ k}\Omega / < 1.5\text{ nF}$
 Sensor supply - pin 44, programmable $5 - 17\text{ V} / 20\text{ mA}$

TTL input:

Trig-level LOW	≤ 0.8 VDC
Trig-level HIGH	≥ 2.0 VDC
Input impedance	≥ 100 k Ω / < 1.5 nF
Sensor supply - pin 44, programmable	5 -17 V / 20 mA

S0 input acc. to DIN 43864:

Trig-level LOW	≤ 2.2 mA
Trig-level HIGH	≥ 9.0 mA
Input impedance	758 Ω / < 1.5 nF
Sensor supply - pin 44, fixed	17 V

Special voltage input:

User programmable trig-levels.....	-0.05...6.50 V
Hysteresis, min.....	50 mV
Input impedance, selectable:	
High Z	≥ 100 k Ω / < 1.5 nF
Pull up and pull down.....	3.48 k Ω / < 1.5 nF
Sensor supply - pin 44, programmable	5 -17 V / 20 mA

Special current input:

User programmable trig-levels.....	0.0...10.0 mA
Hysteresis, min.....	0.2 mA
Input impedance	1 k Ω / < 1.5 nF
Sensor supply - pin 44, programmable	5 -17 V / 20 mA

Output:

Display:

Display readout	-1999...9999 (4 digits)
Decimal point	Programmable
Digit height	13.8 mm
Display updating	2.2 times / sec.
Input frequency outside range & Namur input sensor error is indicated by.....	Explanatory text

Current output (5725D):

Programmable signal ranges	0...20, 4...20 & 20...0, 20...4 mA
Load (max.).....	20 mA / 800 Ω / 16 VDC
Current limit.....	\leq 28 mA
Load stability.....	\leq 0.01% of span / 100 Ω
Programmable response time.....	1.0...60.0 sec
Sensor error indication, at Namur input: selectable	0 / 3.5 / 23 mA / none
Output limitation at outside range: on 4...20 and 20...4 mA signals.....	3.8...20.5 mA
on 0...20 and 20...0 mA signals.....	0...20.5 mA

Relay outputs (5725D):

Relay function.....	Setpoint
Hysteresis, in % / display counts	0.1...100% / 1...9999
On and Off delay	0...3600 sec
Power On delay.....	1.0...60.0 sec
Sensor error action.....	Make / Break / Hold
Max. voltage.....	250 VRMS
Max. current	2 A / AC
Max. AC power	500 VA
Max. current at 24 VDC.....	1 A

Approvals:

EMC 2004/108/EC	EN 61326-1
LVD 2006/95/EC.....	EN 61010-1
UL, Standard for Safety	UL 508
GOST R	

Marine:

Det Norske Veritas, Ships & Offshore	Stand. f. Certific. No. 2.4
--	-----------------------------

Sensor error indication, inside and outside range

Sensor error indication in 5725, only available for NAMUR input:				
Condition	Out of range limit	Relay behaviour	Analogue output value	Display readout
Sensor input type = NAMUR and sensor error detection = ON	> 6.9 mA	Set to user defined value: HOLD. ACTIVE. DEACTIVE or NONE	Set to user-defined value (23, 0, 3.5 mA or NONE)	"SE.SH"
	< 0.1 mA			"SE.BR"

Input "out of range" indication		
Valid measurement range:	Out of range limit	Display readout
F to I function: 0.001 Hz to 50 kHz	< 0.0009 Hz - equals "Low cut off time"	"0" or "IN.LO" if 0% input value is set different from "0"
	> 50.5 kHz	"IN.HI"
Period time function: 20 µs to 999.9 s	>1111 s (18 min. 31 sec.) - equals "Low cut off time"	"IN.LO"
	< 19.8 µs	"IN.HI"


Display out of range Indication		
Valid display value range:	Out of range limit	Display readout
-1999 to 9999	< -1999	"-1.9.9.9." - flashing
	> 9999	"9.9.9.9." - flashing

Hardware error indication		
Error explanation	Error cause	Display readout
Error in internal communication (SPI etc.)	Permanent error in inter-communication between microcontrollers	"HW.ER"
Error in checksum test of the configuration in RAM	Error in RAM	"RA.ER"
Error in checksum test of the configuration in EEPROM	Error in EEPROM	"EE.ER"
Error in OK check or checksum test of the calibration data in FLASH	Error in FLASH or Calibration has not been performed or Calibration data in FLASH are corrupt	"NO.CA"

! Error indications in the display blink once a second. The help text explains the error.


CONNECTIONS

Supply:




Inputs:


Special current




Special voltage




Tacho




PNP




NPN




Contact (NPN)




Namur



S0




TTL




Output:


Current



Relays



BLOCK DIAGRAM

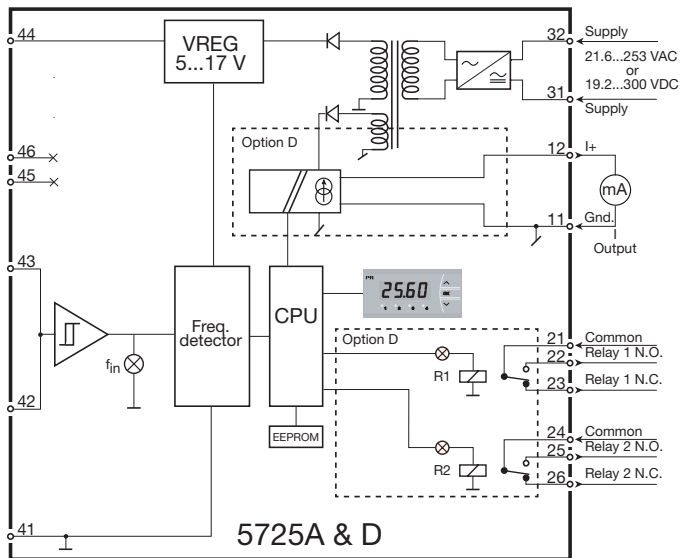

CONFIGURATION / OPERATING




THE FUNCTION KEYS


Documentation for the routing diagram

In general:

When configuring the display you are guided through all parameters, allowing you to choose the settings which fit the application. For each menu there is a scrolling help text which is automatically shown in the display if no key has been activated for appr. 5 seconds.

Configuration is carried out by way of the 3 function keys   and .





 will increase the numerical value or choose the next parameter.  will decrease the numerical value or choose the previous parameter.  will accept the chosen value and go to the next menu. If a function does not exist in the hardware, all parameters belonging to that function will be skipped in order to make configuration as simple as possible. The configuration will not be saved until the end of the menu structure when the display shows ---.

Pressing and holding  will return to the previous menu or go back to the default state ("Monitor") without saving the changed values or parameters.

If no key is activated for 2 minutes, the display will return to the default state ("Monitor") without saving the changed values or parameters.

Further explanations:

Fast setpoint adjustment and relay test (only 5725D):

These menus are interactive and allow you to adjust the setpoints while the display is measuring the input signal. The front LED's will then indicate when the relays change state, thus easing the setpoint adjustment in many situations. By activating  and  simultaneously, a relay test will be initiated and the relay will change state. The setpoint adjustment will be saved by a quick press of . Holding down  for more that 0.5 seconds will return the display to the default state ("Monitor") without changing the setpoint.

Password protection

Using a password will block access to the menu and parameters.

Default password 2008 allows access to all configuration menus.

5725D only: There are two levels of password protection.


Passwords between 0000 and 4999 allow access to the fast setpoint adjustment and relay test menus (using this password blocks access to all other parts of the menu).

Passwords between 5000 and 9999 block access to all parts of the menu, fast setpoint and relay test (current setpoint is still shown).


ROUTING DIAGRAM FOR 5725A

If no key is activated for 2 minutes, the display returns to default state "Monitor" without saving configuration changes.

- ⊙ Increase value / choose next parameter
- ⊖ Decrease value / choose previous parameter
- ⊗ Accept the chosen parameter and go to the next menu
- Hold ⊗ Back to previous menu / return to default state "Monitor" without saving.

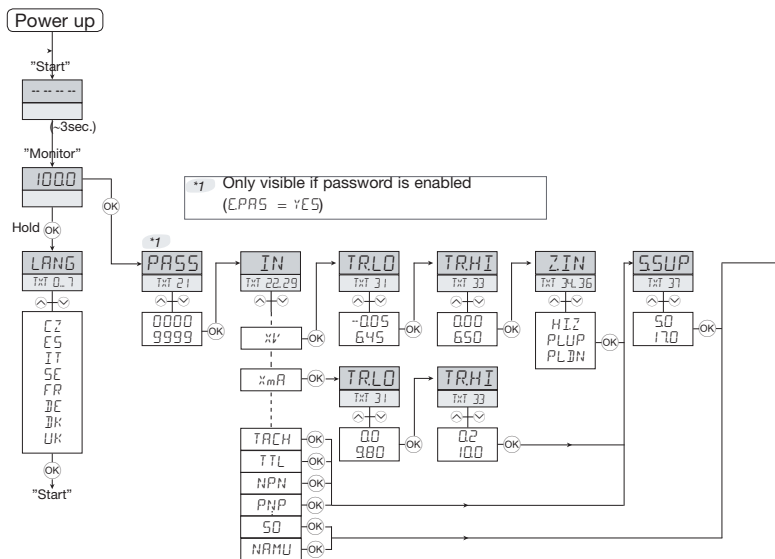

- *1 Only visible if password is enabled (EPAS = YES)
- *2
- *3
- *4 Displays either Hz/kHz or s/ms for 1 sec. before actual value is displayed.
When value hits digit-limit while scrolling, either Hz/kHz or s/ms is displayed again for 1 sec. to show the user that the new range is active.
- *5 Only visible if max. (INLO, INHI) value is ≤ 50 Hz (F/I) or ≥ 20 ms (Period time)
Default if visible = YES, else deactivated.
- *6
- *7
- *8
- *9 Minimum INHI value is automatically limited to 1 display count above INLO

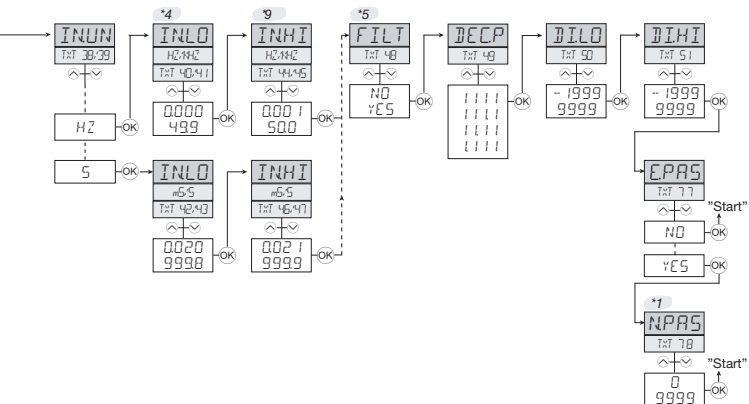

ROUTING DIAGRAM FOR 5725D


If no key is activated for 2 minutes, the display returns to default state "Monitor" without saving configuration changes.

⬆ Increase value / choose next parameter

⬇ Decrease value / choose previous parameter

⊗ Accept the chosen parameter and go to the next menu

Hold ⊗ Back to previous menu / return to default state "Monitor" without saving.

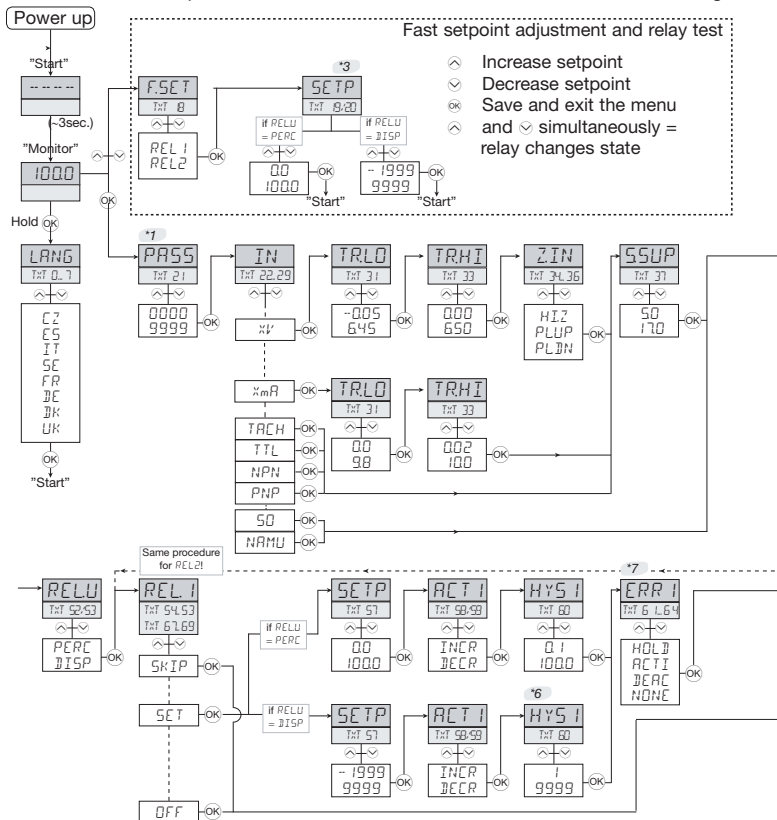



SCROLLING HELP TEXTS

Top line	Scrolling text	TEXT NR	TR.LO	(when special voltage input is selected)	
Language menu			xxxx	SET LOW TRIGGER LEVEL IN VOLT	30
UK	UK - SELECT ENGLISH HELP TEXT	0			
DK	DK - VÆLG DANSK HJÆLPETEKST	1	TR.LO	(when special current input is selected)	
DE	DE - WÄHLE DEUTSCHEN HILFETEXT	2	xxxx	SET LOW TRIGGER LEVEL IN mA	31
FR	FR - SELECTION TEXTE D'AIDE EN FRANCAIS	3			
SE	SE - VALJ SVENSK HJALPTEXT	4	TR.HI	(when special voltage input is selected)	
IT	IT - SELEZIONARE TESTI DI AIUTO ITALIANI	5	xxxx	SET HIGH TRIGGER LEVEL IN VOLT	32
ES	ES - SELECCIONAR TEXTO DE AYUDA EN ESPANOL	6			
CZ	CZ - VYBER CESKOU NAPOVEDU	7	TR.HI	(when special current input is selected)	
			xxxx	SET HIGH TRIGGER LEVEL IN mA	33
Error indication					
(when active, labels are flashing @ app. 1 Hz)			Z.IN	(when special voltage input is selected)	
SE.BR	SENSOR WIRE BREAKAGE	8	HI.Z	SET INPUT RESISTANCE HIGH	34
IN.HI	INPUT OVERRANGE	9	PL.UP	SET INPUT PULL UP	35
SE.SH	SENSOR SHORT CIRCUIT	0	PL.DN	SET INPUT PULL DOWN	36
IN.LO	INPUT UNDERRANGE	11			
9.9.9.9.	DISPLAY OVERRANGE	12	S.SUP	(not when NAMUR or S0 input is selected)	
-1.9.9.9.	DISPLAY UNDERRANGE	13	xxxx	SET SENSOR SUPPLY VOLTAGE	37
HW.ER	HARDWARE ERROR	14			
EE.ER	EEPROM ERROR - CHECK CONFIGURATION	15	IN.UN		
RA.ER	RAM MEMORY ERROR	16	HZ	SET INPUT UNIT FOR FREQUENCY	38
NO.CA	DEVICE NOT CALIBRATED	17	S	SET INPUT UNIT FOR PERIOD TIME	39
Fastset Menu			IN.LO		
F.SET			xxxx	SET INPUT RANGE LOW IN HZ	40
REL1	FAST SET MENU - SELECT RELAY	18	xxxx	SET INPUT RANGE LOW IN KHZ	41
REL2	FAST SET MENU - SELECT RELAY	19	xxxx	SET INPUT RANGE LOW IN S	42
			xxxx	SET INPUT RANGE LOW IN mS	43
SETP	(if fastset is enabled)				
xxxx	RELAY SETPOINT - PRESS OK TO SAVE	20	IN.HI		
			xxxx	SET INPUT RANGE HIGH IN HZ	44
SETP	(if fastset is disabled)		xxxx	SET INPUT RANGE HIGH IN KHZ	45
xxxx	RELAY SETPOINT - READ ONLY	21	xxxx	SET INPUT RANGE HIGH IN S	46
			xxxx	SET INPUT RANGE HIGH IN mS	47
Configuration setup			FILT		
PASS			NO	ENABLE INPUT FILTER	48
xxxx	SET CORRECT PASSWORD	21	YES	ENABLE INPUT FILTER	48
IN			DEC.P		
PNP	PNP SENSOR INPUT	22	1111	DECIMAL POINT POSITION	49
NPN	NPN SENSOR INPUT	23	111.1	DECIMAL POINT POSITION	49
TTL	TTL SENSOR INPUT	24	11.11	DECIMAL POINT POSITION	49
NAMU	NAMUR SENSOR INPUT	25	1.111	DECIMAL POINT POSITION	49
S0	S0 SENSOR INPUT	26			
TACH	TACHO SENSOR INPUT	27	DI.LO		
XmA	SPECIAL CURRENT SENSOR INPUT	28	xxxx	DISPLAY READOUT LOW	50
XV	SPECIAL VOLTAGE SENSOR INPUT	29			
			DI.HI		
			xxxx	DISPLAY READOUT HIGH	51

REL.U		
PERC	SET RELAY IN PERCENTAGE	52
DISP	SET RELAY IN DISPLAY UNITS	53
REL1		
OFF	RELAY 1 DISABLED	54
SETP	ENTER RELAY 1 SETUP	55
SKIP	SKIP RELAY 1 SETUP	56
SETP		
xxxx	RELAY SETPOINT	57
ACT1		
INCR	ACTIVATE AT INCREASING SIGNAL	58
DECR	ACTIVATE AT DECREASING SIGNAL	59
HYS1		
xxxx	RELAY HYSTERESIS	60
ERR1		
HOLD	HOLD RELAY AT ERROR	61
ACTI	ACTIVATE RELAY AT ERROR	62
DEAC	DEACTIVATE RELAY AT ERROR	63
NONE	UNDEFINED STATUS AT ERROR	64
ON.DE		
xxxx	RELAY ON-DELAY IN SECONDS	65
OF.DE		
xxxx	RELAY OFF-DELAY IN SECONDS	66
REL2		
OFF	RELAY 2 DISABLED	67
SETP	ENTER RELAY 2 SETUP	68
SKIP	SKIP RELAY 2 SETUP	69
SETP		
xxxx	RELAY SETPOINT	57
ACT2		
INCR	ACTIVATE AT INCREASING SIGNAL	58
DECR	ACTIVATE AT DECREASING SIGNAL	59
HYS2		
xxxx	RELAY HYSTERESIS	60
ERR2		
HOLD	HOLD RELAY AT ERROR	61
ACTI	ACTIVATE RELAY AT ERROR	62
DEAC	DEACTIVATE RELAY AT ERROR	63
NONE	UNDEFINED STATUS AT ERROR	64
ON.DE		
xxxx	RELAY ON-DELAY IN SECONDS	65

OF.DE		
xxxx	RELAY OFF-DELAY IN SECONDS	66
PO.DE		
xxxx	RELAY POWER ON DELAY IN SECONDS	70
A.OUT		
20-4	OUTPUT RANGE IN mA	71
20-0	OUTPUT RANGE IN mA	71
4-20	OUTPUT RANGE IN mA	71
0-20	OUTPUT RANGE IN mA	71
O.ERR		
23mA	NAMUR NE43 UPSCALE AT ERROR	72
3.5mA	NAMUR NE43 DOWNSCALE AT ERROR	73
0mA	DOWNSCALE AT ERROR	74
NONE	UNDEFINED OUTPUT AT ERROR	75
RESP		
xxxx	ANALOG OUTPUT RESPONSE TIME IN SECONDS	76
E.PAS		
NO	ENABLE PASSWORD PROTECTION	77
YES	ENABLE PASSWORD PROTECTION	77
N.PAS	(when password enabled)	
xxxx	SELECT NEW PASSWORD	78

Graphic depiction of the relay function setpoint

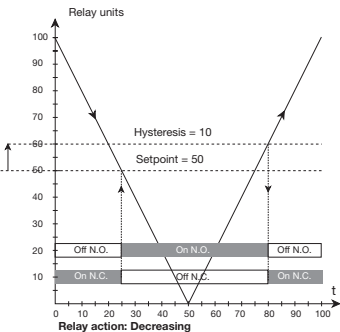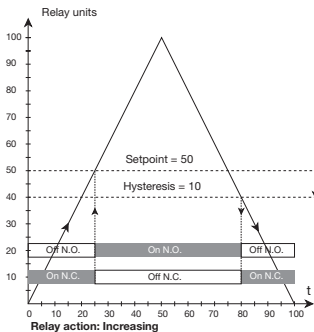



Displays Programmable displays with a wide selection of inputs and outputs for display of temperature, volume and weight, etc. Feature linearisation, scaling, and difference measurement functions for programming via PReset software.



Ex interfaces Interfaces for analogue and digital signals as well as HART® signals between sensors / I/P converters / frequency signals and control systems in Ex zone 0, 1 & 2 and for some modules in zone 20, 21 & 22.



Isolation Galvanic isolators for analogue and digital signals as well as HART® signals. A wide product range with both loop-powered and universal isolators featuring linearisation, inversion, and scaling of output signals.
























Temperature A wide selection of transmitters for DIN form B mounting and DIN rail modules with analogue and digital bus communication ranging from application-specific to universal transmitters.



Universal PC or front programmable modules with universal options for input, output and supply. This range offers a number of advanced features such as process calibration, linearisation and auto-diagnosis.



- 
 www.preelectronics.fr
 sales@preelectronics.fr
- 
 www.preelectronics.de
 sales@preelectronics.de
- 
 www.preelectronics.es
 sales@preelectronics.es
- 
 www.preelectronics.it
 sales@preelectronics.it
- 
 www.preelectronics.se
 sales@preelectronics.se
- 
 www.preelectronics.co.uk
 sales@preelectronics.co.uk
- 
 www.preelectronics.com
 sales@preelectronics.com

Head office

Denmark
 PR electronics A/S
 Lerbakken 10
 DK-8410 Rønede

www.preelectronics.com
sales@preelectronics.dk
 tel. +45 86 37 26 77
 fax +45 86 37 30 85



QUALITY SYSTEM AND ENVIRONMENTAL MANAGEMENT SYSTEM
 DS/EN ISO 9001
 DS/EN ISO 14001

